


# FREEZELESS SILLCOCK

**FUNCTION:** For installation in interior or exterior building walls where an exposed hose connection is acceptable. Self-Draining feature provides positive non-freeze protection and integral vacuum breaker provides backflow protection.

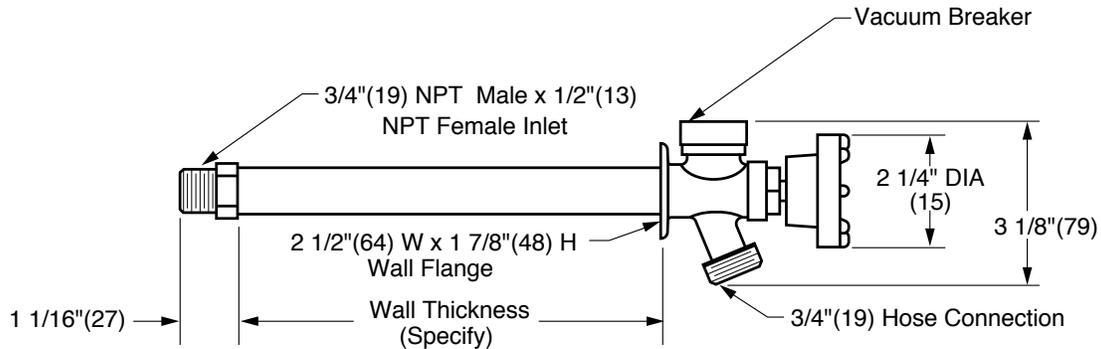

<input type="checkbox"/>	Fig. 5630-04	4(100) Wall Thickness
<input type="checkbox"/>	Fig. 5630-06	6(150) Wall Thickness
<input type="checkbox"/>	Fig. 5630-08	8(205) Wall Thickness
<input type="checkbox"/>	Fig. 5630-10	10(255) Wall Thickness
<input type="checkbox"/>	Fig. 5630-12	12(305) Wall Thickness

**NOTES:**

1. Recommended wall opening 1 1/4"(32). Hydrant shall be installed in horizontal position only with hose connection pointing down.
2. When ordering, specify wall thickness in 02"(51) increments as follows: 04(100), 06(150), 08(205) 10(255) or 12 (305).
3. All Jay R. Smith hydrants are manufactured with "NO-LEAD" brazing rings and USDA approved lubricants.
4. The AB1953, California Lead Law and NSF/ANSI Standard 61-2008 - Drinking Water Components are not applicable to Jay R. Smith hydrants as they do not convey/dispense water for human consumption through drinking or cooking.
5. Dimensions shown in parentheses are in millimeters.
6. **FOR IRRIGATION PURPOSES ONLY.**

**REGULARLY FURNISHED:**

Lead Free Rough Bronze Chrome Plated Non-Freeze Hydrant with Integral Wall Flange and Vacuum Breaker, Wheel Handle and 3/4"(19) Hose Connection. Stainless Steel Box with Key and 180° Cover Opening.

Installer is responsible for providing a 100% watertight positive seal at the hydrant to wall interface. Seal all the flange with an appropriate sealant recommended by a sealant manufacturer. **NOTE: Jay R. Smith does not warrant the performance or life expectancy of the sealant material.**

DRAWING NUMBER  
**s5630**

SIZE  
**A**

SCALE:  
**NONE**

DATE:  
**6-16-11**

APPROVED BY:  
**CL**

CHECKED BY:  
**CL**

DRAWN BY:  
**TBW**

**5630**

FIGURE NUMBER

WE CAN ASSUME NO RESPONSIBILITY FOR USE OF SUPERSEDED OR VOID DATA

DIMENSIONS ARE SUBJECT TO MANUFACTURERS TOLERANCE AND CHANGE WITHOUT NOTICE

C	4-5-18	Added Notes	TBW	BW	WEIGHT POUNDS	VOLUME CUBIC FEET	FIGURE NUMBER
B	10-25-16	Revised Regularly Furnished	TBW	SJM			<b>5630</b>
A	2-4-13	Revised Notes	TBW	CL			
REV.	DATE	DESCRIPTION	BY	CKD. BY			